

INSTRUCTION SHEET



ROOK/FINCH CONDUIT CANOPY MOUNT, CORD SUSPENSION (CDC.C)


689-20102

PAGE 1 OF 1


WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.


- 1 THREAD CORD GRIP BASE INTO CROSSBAR
- 2 ATTACH CROSSBAR TO JUNCTION BOX (B.O.) WITH HARDWARE (B.O.)
- 3 FEED FIXTURE POWER CORD THROUGH CORD GRIP CAP, THEN CANOPY, THEN CORD GRIP BASE, ADJUSTING SUSPENSION HEIGHT. CUT AND STRIP EXCESS POWER CORD AS NEEDED.
- 4 SPLICE FIXTURE WIRES TO INCOMING WIRES
- 5 THREAD CORD GRIP CAP ONTO CORD GRIP BASE, SECURING CANOPY. REMOVE CANOPY KNOCKOUTS AS NEEDED.

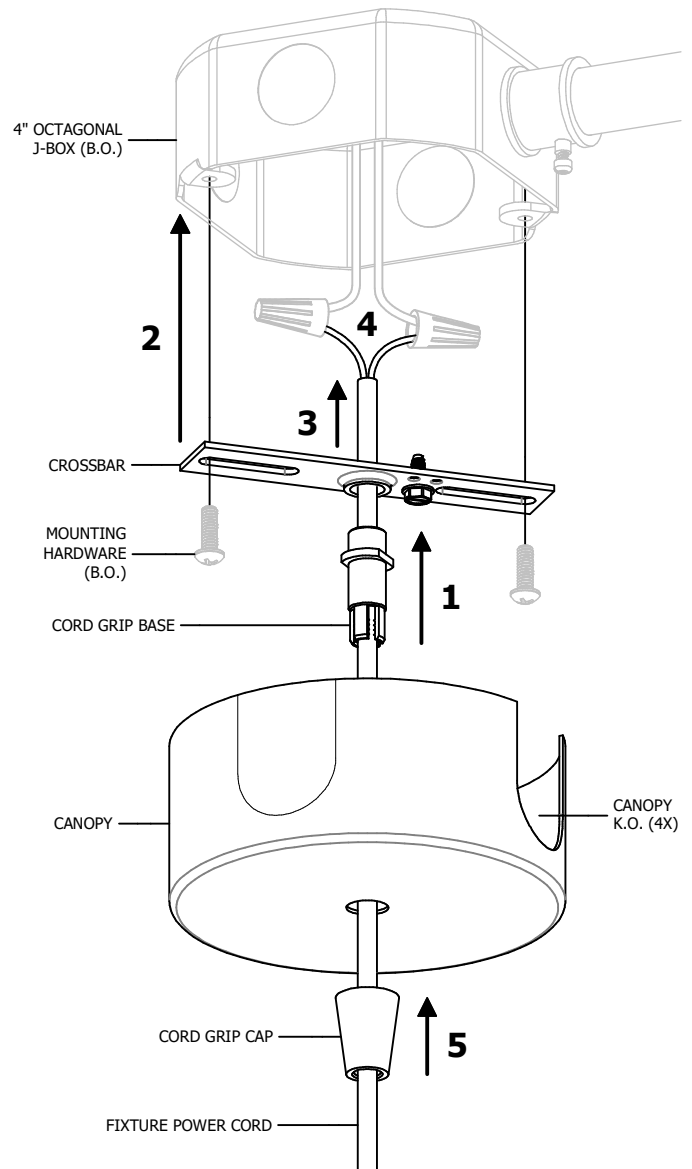


2-WIRE




4-WIRE

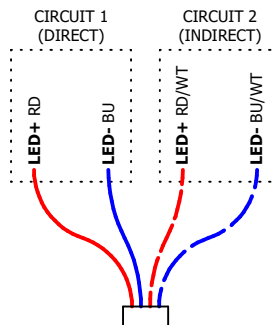

5-WIRE



9-WIRE

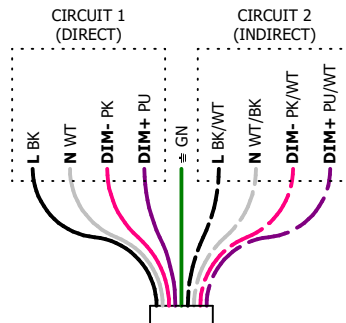

Amerlux, 178 Bauer Drive, Oakland, N.J. 07436, T: 973-882-5010, F: 973-882-2604 www.amerlux.com

INSTRUCTION SHEET



ROOK CONDUIT CANOPY MOUNT, RIGID STEM SUSPENSION (CDC.RS)


689-20103

PAGE 1 OF 1


WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.


- 1** ATTACH CROSSBAR TO JUNCTION BOX (B.O.) WITH HARDWARE (B.O.)
- 2** IF NECESSARY, CUT BOTTOM OF STEM TO LENGTH.
DO NOT CUT END WITH EXTERNAL THREADS.
- 3** FEED FIXTURE WIRES THROUGH STEM, THEN INSERT STEM INTO
FIXTURE HUB & SECURE WITH HUB HARDWARE (2X)
- 4** SLIDE CANOPY OVER STEM, THREAD LOCKNUT ONTO STEM, THEN
THREAD STEM INTO CROSSBAR & SECURE WITH LOCKNUT
- 5** SPLICE FIXTURE WIRES TO INCOMING WIRES
- 6** RAISE CANOPY TO MAGNETIC CROSSBAR, REMOVING CANOPY
KNOCKOUTS AS NEEDED

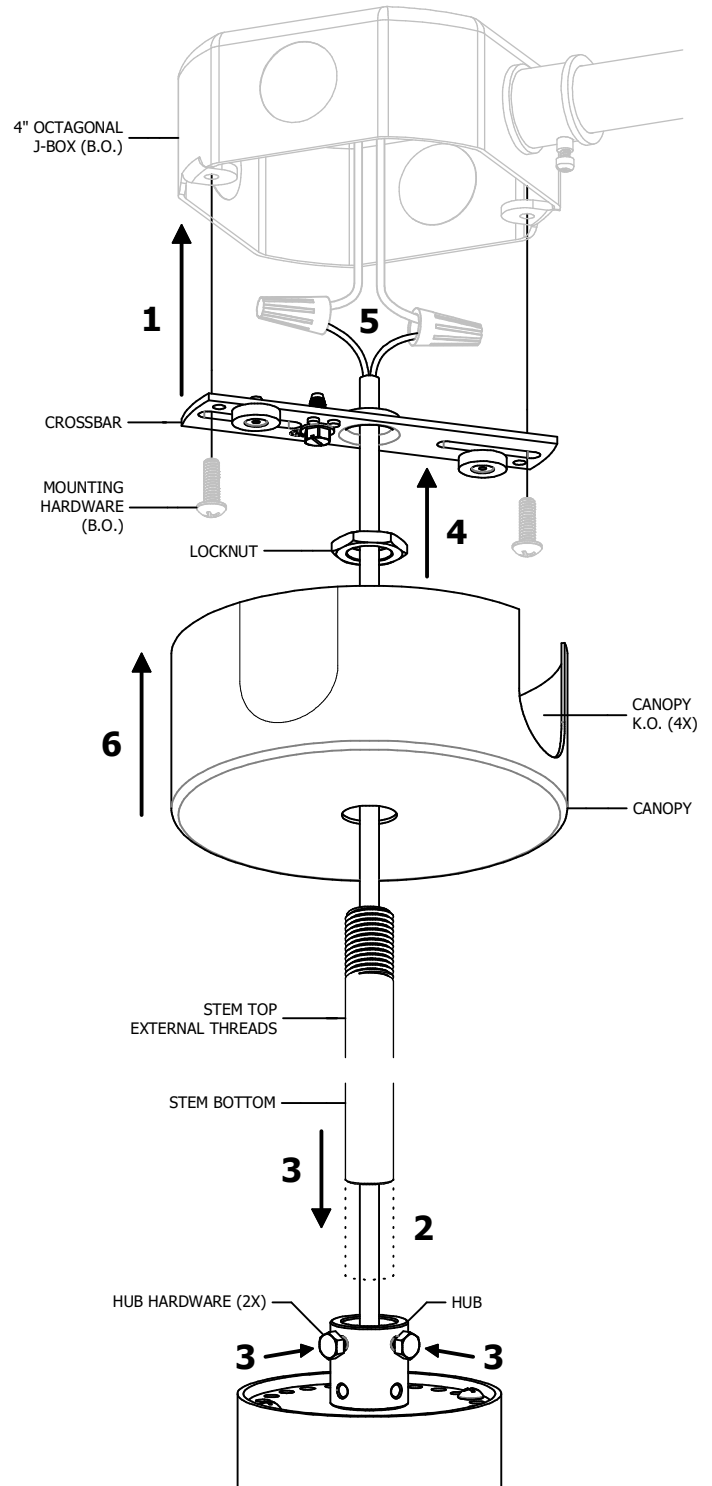


2-WIRE




4-WIRE

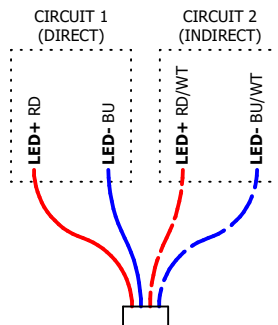

5-WIRE



9-WIRE

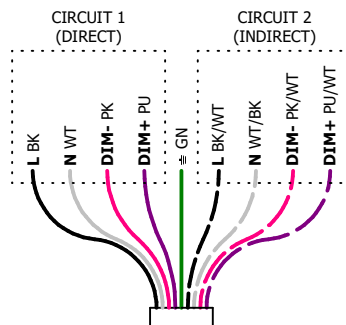

Amerlux, 178 Bauer Drive, Oakland, N.J. 07436, T: 973-882-5010, F: 973-882-2604 www.amerlux.com

REVISION

DATE

APPROVED

INSTRUCTION SHEET



ROOK CONDUIT CANOPY MOUNT, SURFACE SUSPENSION (CDC.SM)


689-20104

PAGE 1 OF 1


WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.


- 1 ATTACH CROSSBAR TO JUNCTION BOX (B.O.) WITH HARDWARE (B.O.)
- 2 ATTACH RING AND CANOPY TO CROSSBAR WITH MOUNTING SCREWS, REMOVING CANOPY KNOCKOUTS AS NEEDED
- 3 ATTACH FIXTURE SAFETY CABLE TO EITHER UNUSED HOLE IN RING
- 4 SPLICE FIXTURE WIRES TO INCOMING WIRES
- 5 RAISE FIXTURE TO RING AND ROTATE CLOCKWISE TO LOCK IN PLACE

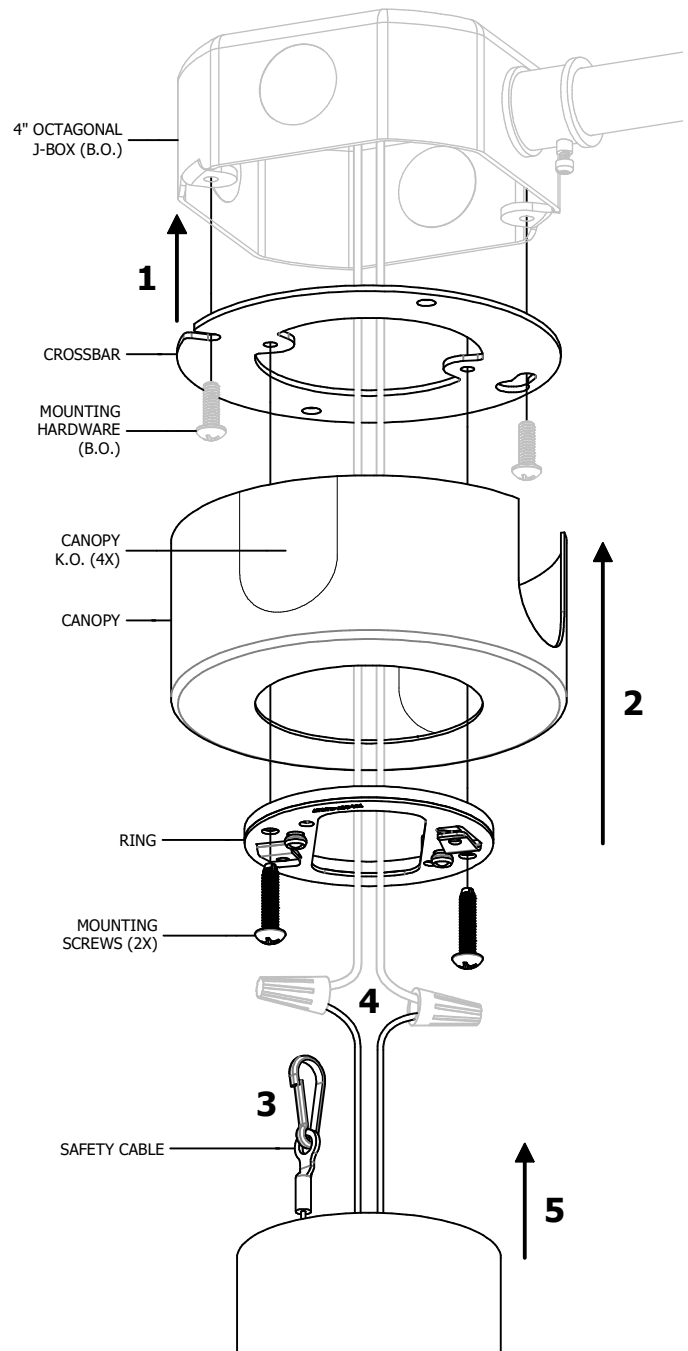

2-WIRE

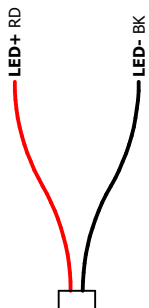

5-WIRE

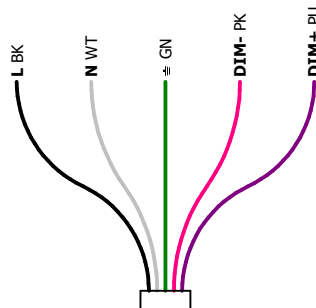

Amerlux, 178 Bauer Drive, Oakland, N.J. 07436, T: 973-882-5010, F: 973-882-2604 www.amerlux.com