

INSTRUCTION SHEET

amerlux
A brand of Delta

ROOK DUAL POWER CANOPY MOUNT, CORD SUSPENSION (PC.C)



689-20195

PAGE 1 OF 1

WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.

- 1** SPLICE INCOMING WIRES TO DRIVER INPUT WIRES ACCORDING TO LOCAL AND NATIONAL CODE
- 2** ATTACH DRIVER BRACKET TO J-BOX WITH MOUNTING HARDWARE (B.O.)
- 3** FEED FIXTURE POWER CORD THROUGH CORD GRIP CAP, THEN CANOPY, THEN CORD GRIP BASE, ADJUSTING SUSPENSION HEIGHT. CUT AND STRIP EXCESS POWER CORD AS NEEDED.
- 4** SPLICE FIXTURE POWER CORD WIRES TO DRIVER OUTPUT WIRES WITH SUPPLIED LEVER CONNECTORS
- 5** FULLY THREAD CORD GRIP CAP ONTO CORD GRIP BASE

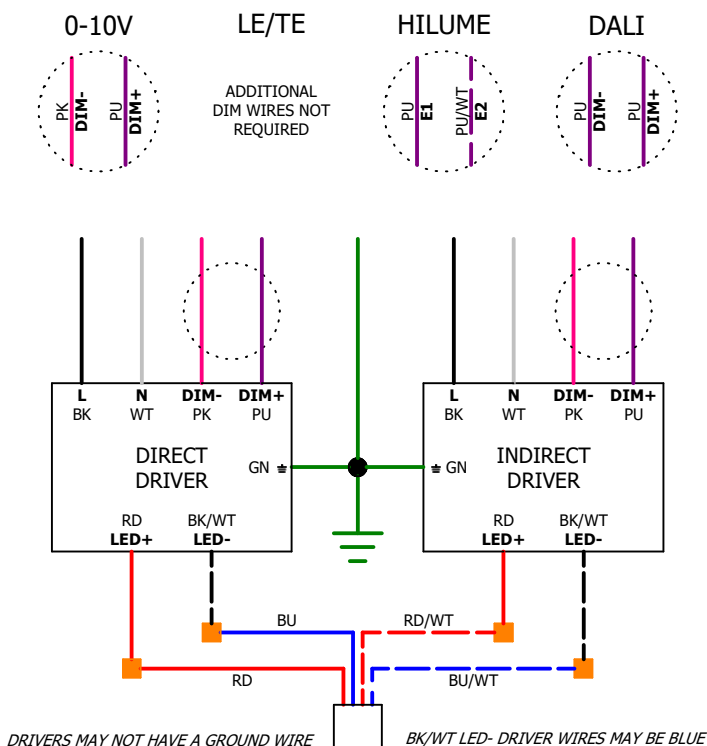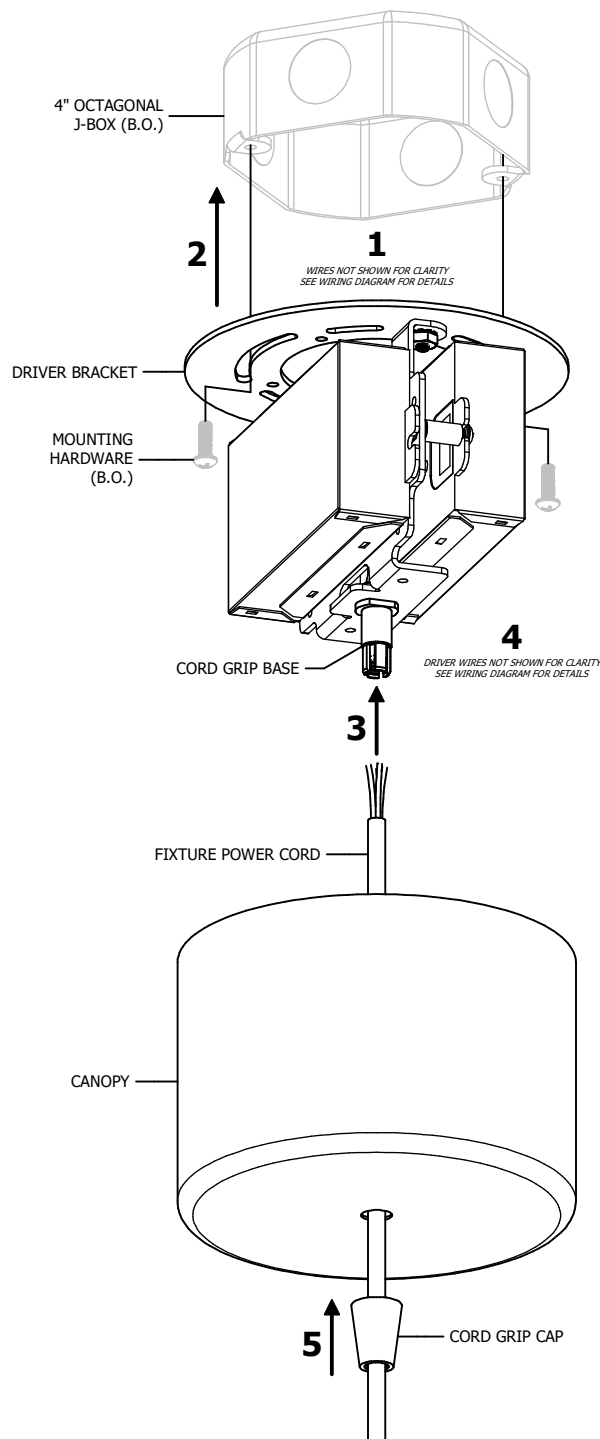

Delta Intelligent Building Technologies | 178 Bauer Drive, Oakland, NJ 07436 | 973-882-5010 | www.amerlux.com

REVISION

DATE

APPROVED

INSTRUCTION SHEET

amerlux
A brand of Delta

ROOK DUAL POWER CANOPY MOUNT, RIGID STEM SUSPENSION (PC.RS)


689-20196

PAGE 1 OF 1

WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.

- 1** SPLICE INCOMING WIRES TO DRIVER INPUT WIRES ACCORDING TO LOCAL AND NATIONAL CODE
- 2** ATTACH DRIVER BRACKET TO J-BOX WITH MOUNTING HARDWARE (B.O.)
- 3** IF NECESSARY, CUT STEM BOTTOM (EXTERNAL THREADS) TO DESIRED LENGTH
- 4** FEED FIXTURE WIRES THROUGH STEM, THEN INSERT STEM INTO FIXTURE HUB & SECURE WITH HUB HARDWARE (2X)
- 5** FEED STEM THROUGH CANOPY, THEN FULLY THREAD STEM ONTO DRIVER BRACKET NIPPLE
- 6** SPLICE FIXTURE WIRES TO DRIVER OUTPUT WIRES WITH SUPPLIED LEVER CONNECTORS
- 7** RAISE CANOPY TO MAGNETIC CROSSBAR

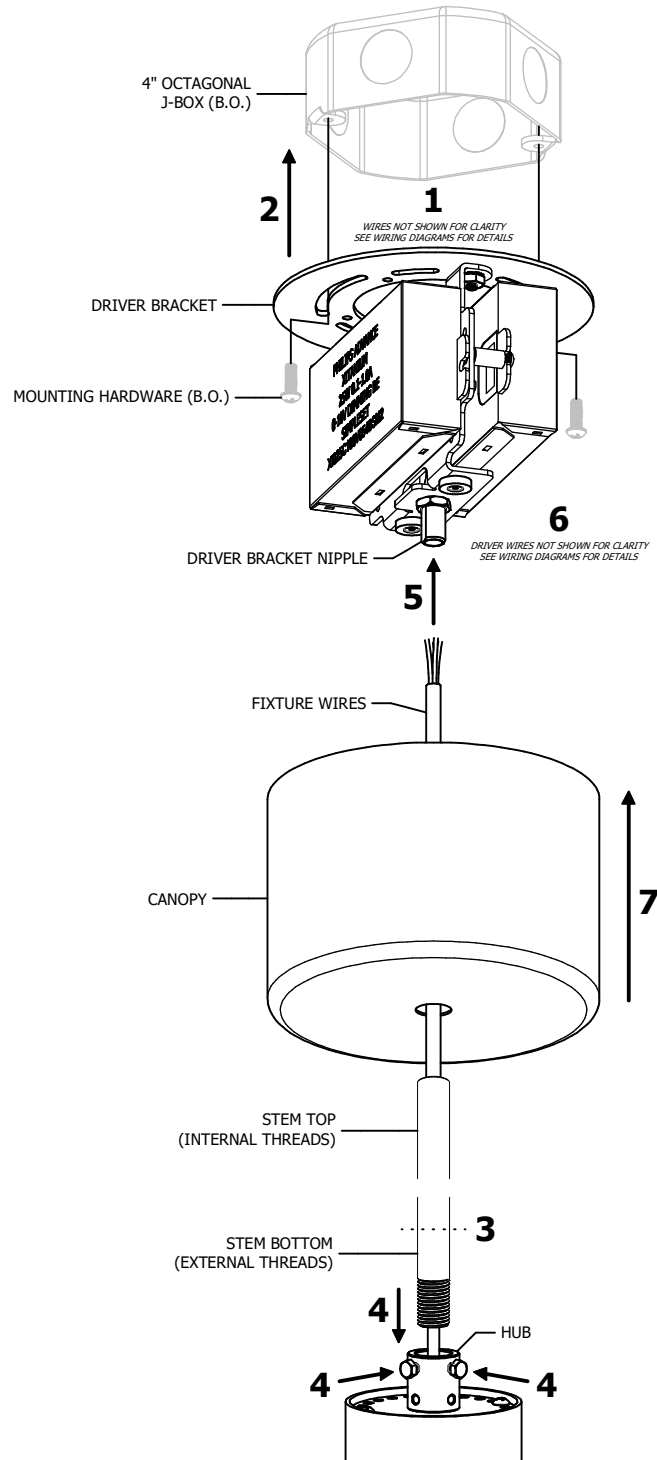


0-10V



LE/TE

HILUME

DALI



ADDITIONAL
DIM WIRES NOT
REQUIRED

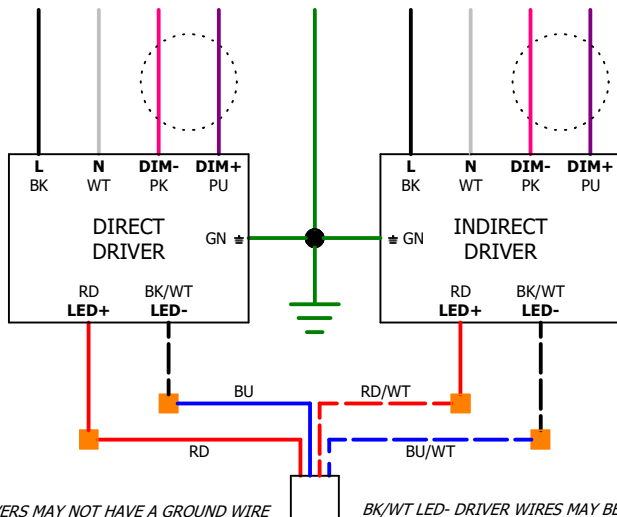

Delta Intelligent Building Technologies | 178 Bauer Drive, Oakland, NJ 07436 | 973-882-5010 | www.amerlux.com

REVISION

DATE

APPROVED